




# EV West - Hyper 9 System Non-Iso System - 96V, 120V - MCU

Revision 1.3 - 6/25

Note: This schematic is **only** for the NON-ISO AC-X1 NetGain/SME Inverter.

Note: For correct operation you must configure the Dilithium BMS Mappable Outputs by sending the following commands through the serial interface (Putty):

- SEND: set out1 fault
- SEND: set out2 plugin
- SEND: set out5 power

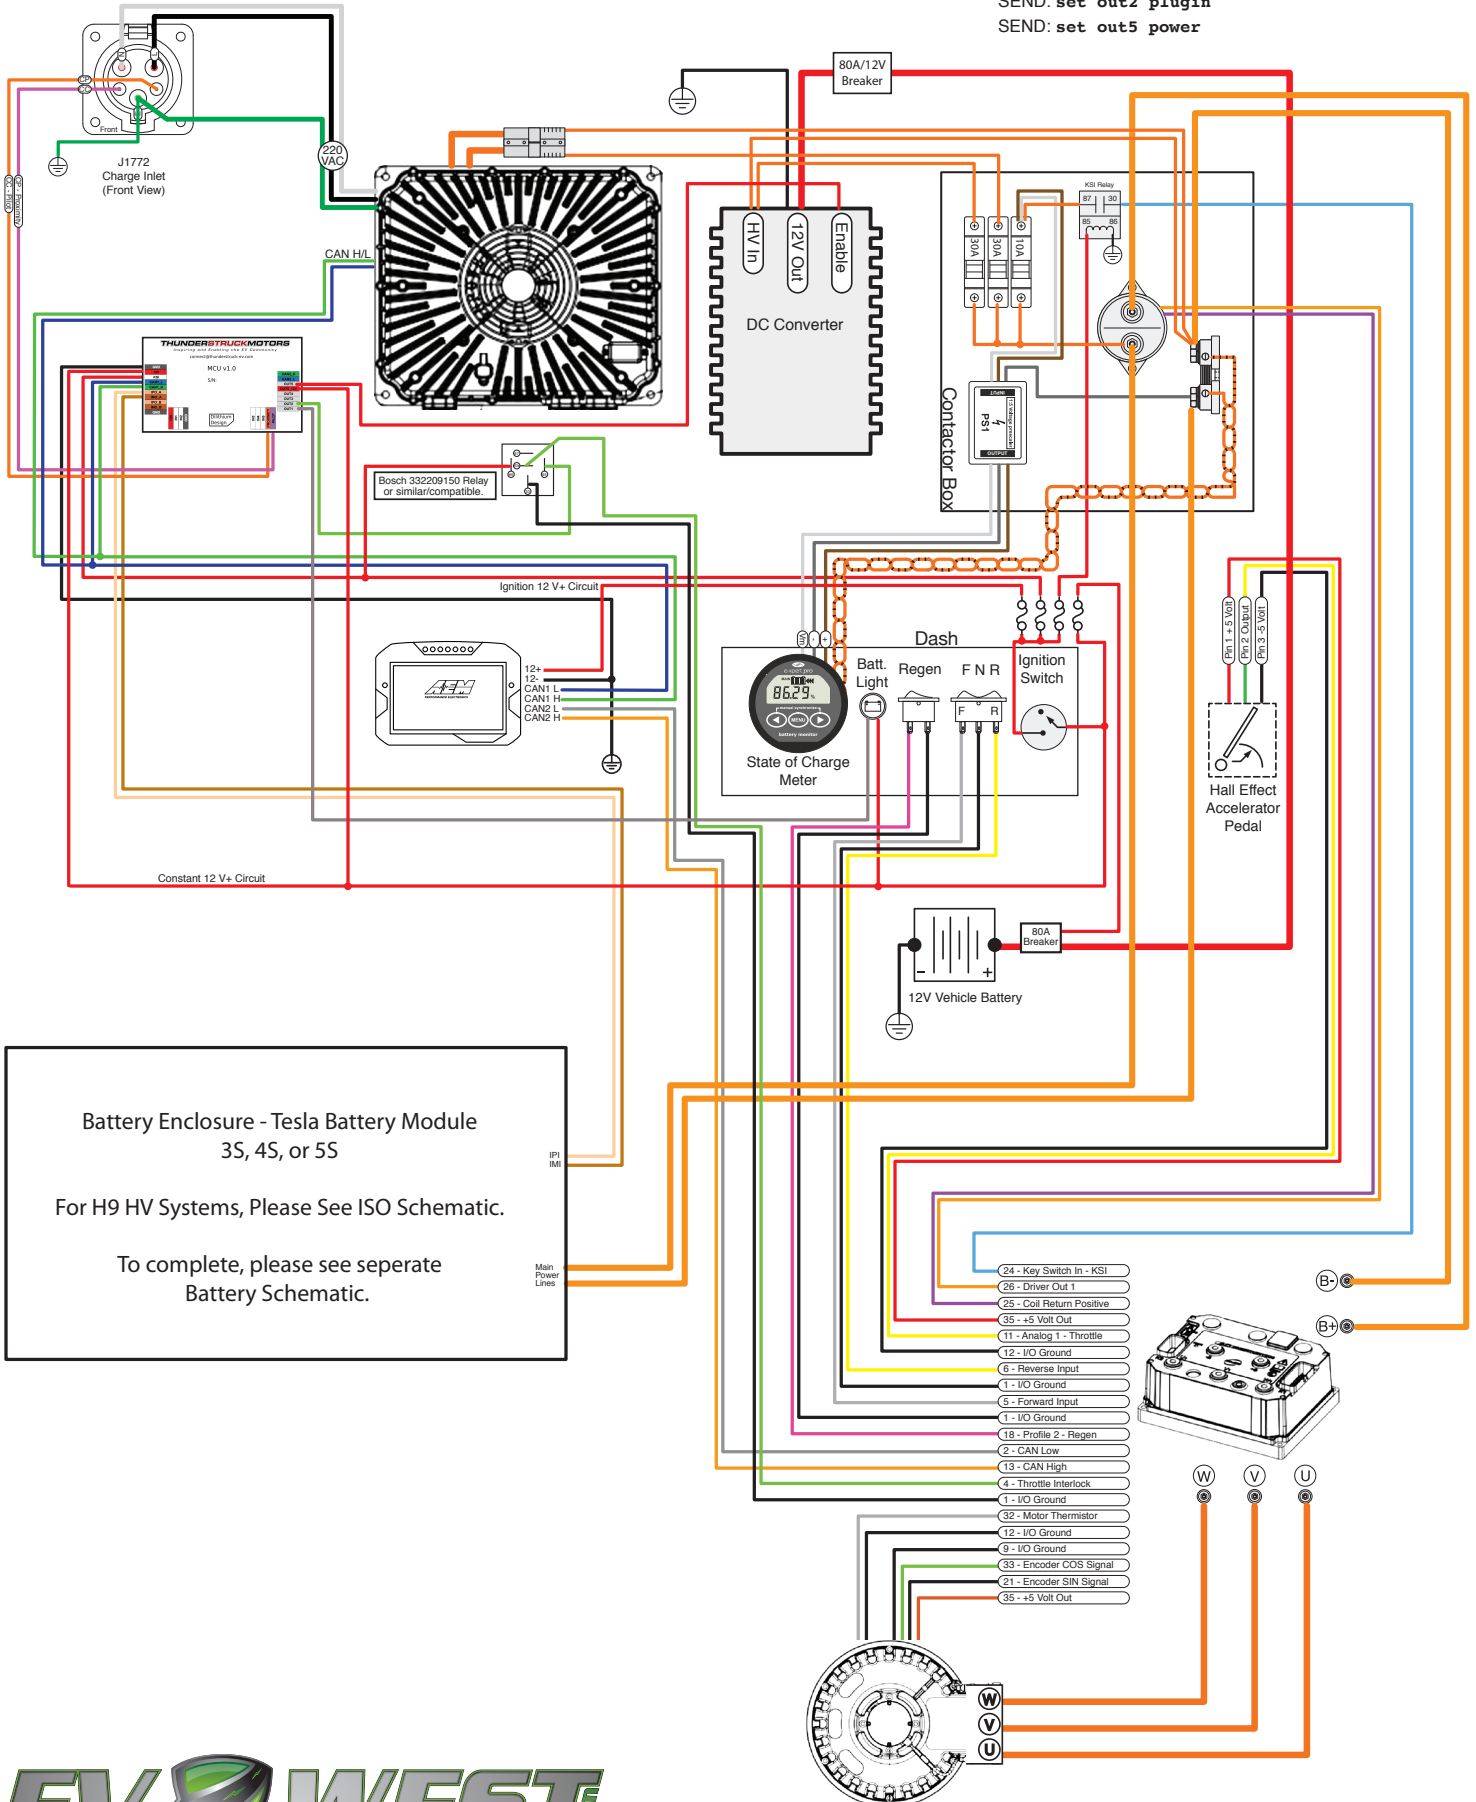

Battery Enclosure - Tesla Battery Module  
3S, 4S, or 5S

For H9 HV Systems, Please See ISO Schematic.

To complete, please see separate  
Battery Schematic.

